

## FLOW METER SCHEDULE


NO	BRAND	NOTES
1	SIGNET	SEE ADDENDUM FOR SPEC.
2	FLOWMS	FV-3, 3"
3	FLOWMS	FV-3, 3"

NOTE: CONTRACTOR SHALL INSTALL ALL FLOW METERS PER MANUFACTURERS REQUIREMENTS.

## POOL VALVE SCHEDULE

NO	TYPE	NOTES
1	BUTTERFLY	
2	BUTTERFLY	
3	BUTTERFLY	EXISTING, NOT SHOWN
4	BUTTERFLY	
5	BUTTERFLY	
6	BUTTERFLY	
7	BUTTERFLY	
8	BUTTERFLY	BRASS VALVE
9	BALL	BRASS VALVE
10	BALL	
11	BUTTERFLY	
12	BUTTERFLY	
13	BUTTERFLY	

NOTES: ALL POOL VALVE REQUIREMENTS ARE IN DIVISION 13 OF SPECIFICATIONS. VALVES SHALL BE SAME SIZE AS PIPE. THIS DETAIL DOES NOT SHOW THE 8 - 2" VALVES REQUIRED ON ALL WALL INLETS.

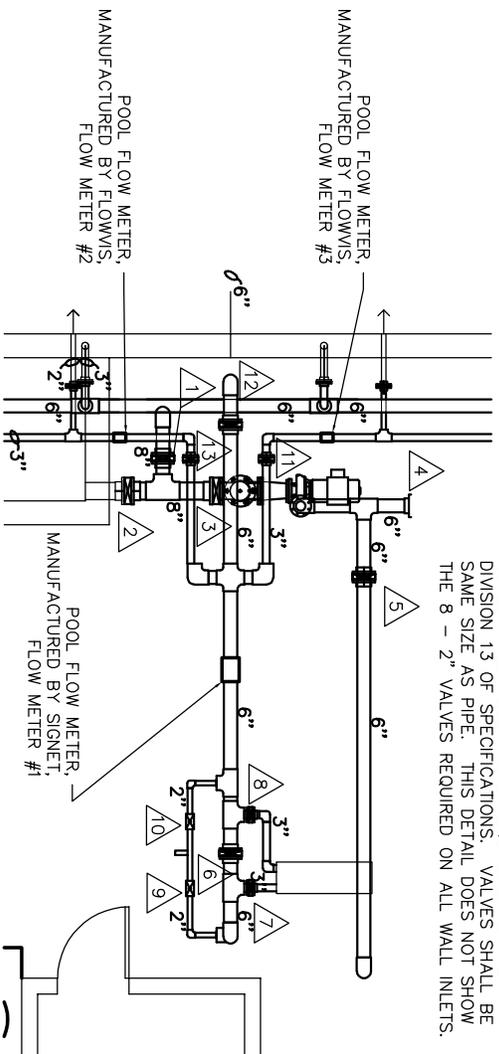

## VALVE & FLOWMETER SCHEDULE

2  
PL2