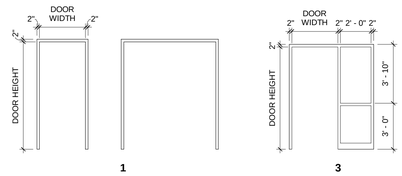

DOOR FRAME ELEVATIONS



DOOR LEAF ABBREVIATIONS:
F - FLUSH
V - VISION LITE
NL - NARROW LITE
HG - HALF GLASS
FG - FULL GLASS

ADDITIONAL ABBREVIATIONS:
ALUM - ALUMINUM
ANOD - ANODIZED
GHM - GALVANIZED HOLLOW METAL
HM - HOLLOW METAL
HPC - HIGH-PERFORMANCE COATING
SCW - SOLID CORE WOOD
HCW - HOLLOW CORE WOOD
WD - WOOD
PT - PAINT
ST - STAIN
KYR - KYNAR

DOOR LEAF ELEVATIONS

DOOR SCHEDULE - CBRF

DOOR NUMBER	LABEL	LEAF SIZE W	LEAF SIZE H	LEAF THICKNESS	LEAF TYPE	LEAF MATERIAL	LEAF FINISH	FRAME TYPE	FRAME MATERIAL	FRAME FINISH	NOTES
LEVEL 1 - FIRST FLOOR											
1050A		7' - 6"	7' - 0"		FG	ALUM	ANOD	1	ALUM	ANOD	1
1050B		7' - 6"	7' - 0"		FG	ALUM	ANOD	1	ALUM	ANOD	2
1052A	45 Min.	3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	6
1052B	45 Min.	3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	6
1053		3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1054		3' - 6"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1055		3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1056		3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	6
1056B		3' - 0"	7' - 0"	1 3/4"	FG	WD	ST	1	HM	PT	4
1058	45 Min.	3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	5
1058B		4' - 0"	7' - 0"	1 3/4"	F	HM	ST	1	HM	PT	6
1060		3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	6
1061	45 Min.	3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	10
1063		3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	9
1064		3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	9
1065		3' - 10"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	
1066		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1067		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1068		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1069		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1070		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1071		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1072		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1073		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1074		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1075		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1076		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1077		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1078		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1079		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1080	45 Min.	3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	6
1081B		3' - 8"	7' - 0"	1 3/4"	FG	WD	ST	1	HM	PT	3
1084A	45 Min.	3' - 8"	7' - 0"	1 3/4"	NL	WD	ST	1	HM	PT	18
1084B		3' - 0"	7' - 0"	1 3/4"	NL	WD	ST	1	HM	PT	12
1086B	45 Min.	3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	11
1087	20 Min.	3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	11
1088		3' - 10"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	
1089		3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	9
1090	45 Min.	3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	6
1091		3' - 8"	7' - 0"	1 3/4"	FG	WD	ST	1	HM	PT	3
1094		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1095		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1096		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1097		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1098		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1099		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1100		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1101		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1102		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1103		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1104		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1105		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1106		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	7
1107		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	8
1108	20 Min.	3' - 8"	7' - 0"	1 3/4"	NL	WD	ST	1	HM	PT	18
1109	45 Min.	3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	6
1110	45 Min.	3' - 0"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	6
1111		3' - 8"	7' - 0"	1 3/4"	F	WD	ST	1	HM	PT	9

NOTE: SEE DOOR HARDWARE SPECIFICATION FOR ALL HARDWARE NOTES REFERENCED IN THE ABOVE SCHEDULE

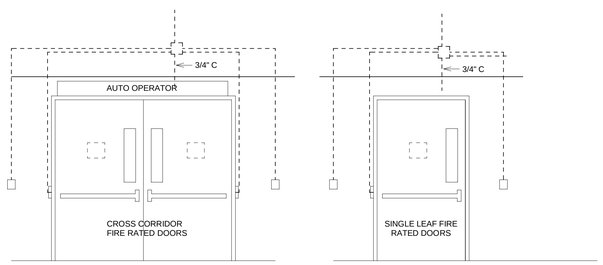

AT THE COMPLETION OF THE PROJECT, THE CONTRACTOR SHALL TEST AND PROVIDE A WRITTEN REPORT OF THE OPERATION OF THE FIRE RATED DOORS.

1. FIRE RATED DOOR WITH AUTOMATIC OPERATORS.
   THE DOORS NEED TO OPERATE PER NFPA 80 WHEN THE FIRE ALARM IS ACTIVATED.
   CONTRACTOR TO CONFIRM SEQUENCE OF DOOR UPON ACTIVATION OF FIRE ALARM.
   VERTICAL RODS ON DOORS THAT ARE HELD IN A RETRACTED POSITION SHALL RELEASE.
   THE DOOR SHALL AUTOMATICALLY CLOSE.
   THE POWER TO THE DOOR SENSOR SHALL BE DROPPED. SENSOR SHALL NOT OPERATE. POWER TO THE OPERATOR SHALL BE DROPPED.
   THE DOOR OPERATOR SHALL ACT AS A CLOSURE WITH LOSS OF POWER. THE DOORS SHALL ONLY OPERATE IN MANUAL SETTING.
   WHEN MANUALLY OPENED, THE DOOR SHALL CLOSE AND LATCH.
   THE VERTICAL GAP BETWEEN THE TWO DOORS IS LESS THAN A 1/4".
   THE GAP AT THE BOTTOM OF THE DOOR IS LESS THAN 1/2".

2. FIRE RATED DOOR WITH HOLD OPENS MAGNETS.
   THE DOORS NEED TO OPERATE PER NFPA 80 WHEN THE FIRE ALARM IS ACTIVATED.
   CONTRACTOR TO CONFIRM SEQUENCE OF DOOR UPON ACTIVATION OF FIRE ALARM.
   VERTICAL RODS ON DOORS THAT ARE HELD IN A RETRACTED POSITION SHALL RELEASE.
   THE DOOR SHALL AUTOMATICALLY RELEASE FROM THE MAGNET AND CLOSE.
   THE DOORS SHALL AUTOMATICALLY LATCH WHEN CLOSED.
   WHEN MANUALLY OPENED, THE DOOR SHALL CLOSE AND LATCH.
   THE GAP AT THE BOTTOM OF THE DOOR IS LESS THAN 1/2".
   ON DOUBLE DOORS, THE VERTICAL GAP BETWEEN THE TWO DOORS IS LESS THAN A 1/4".
   NOTE: THE ACTIVATION IS SIMILAR FOR A SINGLE LEAF FIRE RATED DOOR.

2 FIRE-RATED DOOR DTL.

3/8" = 1'-0"

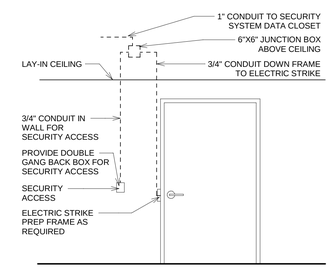

3 SECURITY ACCESS DTL

3/8" = 1'-0"

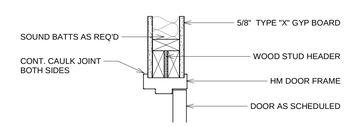

HEAD

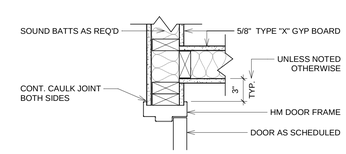

JAMB

WOOD STUD - INTERIOR (TYPICAL)

1 DOOR FRAME DTL.

1 1/2" = 1'-0"

MKM
architecture + design
119 West Wayne Street
Fort Wayne, Indiana 46802
p 260.422.0783
www.MKMdesign.com

Certification:

Consultant Logo:

Key Plan:

ALL IDEAS, DESIGNS, ARRANGEMENTS AND PLANS INDICATED BY THIS DRAWING ARE OWNED BY, AND THE PROPERTY OF MKM ARCHITECTURE + DESIGN, AND WERE CREATED AND DEVELOPED FOR USE ON, AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF THE IDEAS, DESIGNS, ARRANGEMENTS OR PLANS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, FIRM OR CORPORATION FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF MKM ARCHITECTURE + DESIGN. THE OWNER SHALL BE PERMITTED TO RETAIN COPIES FOR INFORMATION AND REFERENCE IN CONNECTION WITH THE PROJECT. WRITTEN DIMENSIONS ON THESE DRAWINGS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB AND THIS OFFICE MUST BE NOTIFIED OF ANY VARIATION FROM THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS. SHOP DRAWINGS MUST BE SUBMITTED TO THIS OFFICE FOR REVIEW BEFORE PROCEEDING WITH FABRICATION. ALL DIMENSIONS, ALL WORK SHOWN ON THIS DOCUMENT, AND THE CORRESPONDING SPECIFICATIONS, INTERFACES WITH WORK SHOWN ON OTHER DOCUMENTS INCLUDING WORK TO BE PERFORMED BY OTHER CONTRACTORS OR SUBCONTRACTORS. EACH CONTRACTOR OR SUBCONTRACTOR SHALL BE FAMILIAR WITH WORK SHOWN ON OTHER DOCUMENTS THAT AFFECT HIS WORK, WHETHER OR NOT SHOWN ON THIS DOCUMENT, WHICH IMPACTS THE WORK SHOWN HEREIN AND SHALL COORDINATE SUCH WORK SO AS TO BE IN COMPLIANCE WITH THE INTENT OF ALL THE PROJECT DOCUMENTS.

MARATHON COUNTY

North Central Health Care
Person centered. Outcome focused.

NORTH CENTRAL HEALTH CARE
NEW CBRF & YOUTH HOSPITAL
2400 MARSHALL ST.
WAUSAU, WI 54403

REVISION

No.	Date	Revision

DRAWING CONTENTS:
DOOR SCHEDULE/
DETAILS - CBRF

ISSUE DATE: 08.08.2019
PROJECT NO. 18064

DRAWING NO.
A-601a

Plot Time/Date 8/27/2019 12:44:08 PM
Drawing Name: R:\18064.dwg