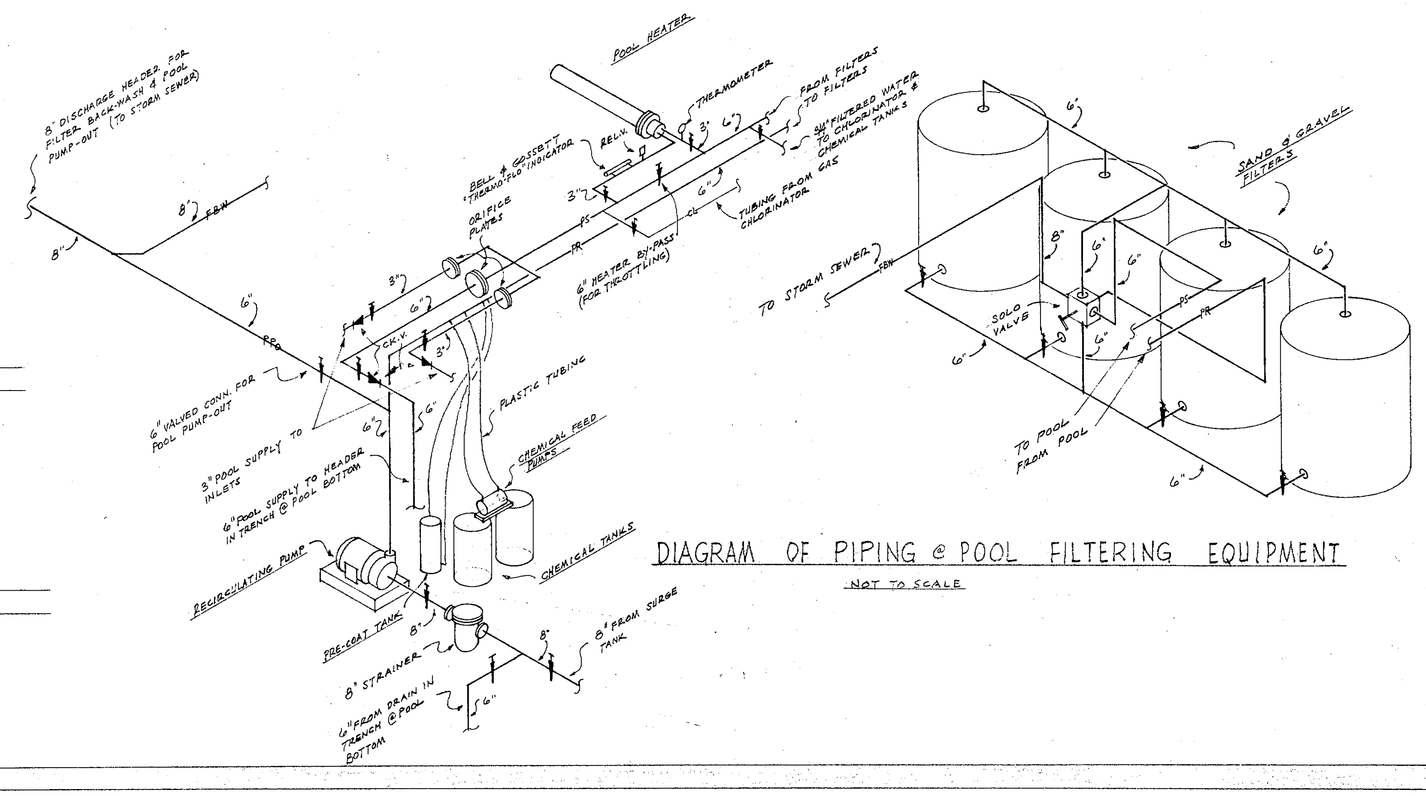

DIAGRAM OF PIPING @ POOL FILTERING EQUIPMENT

NOT TO SCALE

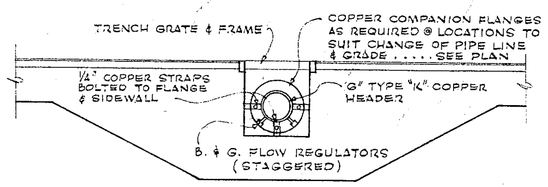

TYPICAL SECTION THRU PIPE TRENCH

(AT POOL BOTTOM) SCALE: 3/4" = 1'-0"

NOTE: STAINLESS STEEL - TYPE 304 OR 316 MAY BE USED IN LIEU OF COPPER PIPE.

POOL PIPING SYMBOLS	
SYMBOLS	DESCRIPTION
PS	POOL SUPPLY
PR	POOL RETURN
GD	GUTTER DRAIN
CL	CHLORINE
PPO	POOL PUMP OUT
FBW	FILTER BACK-WASH

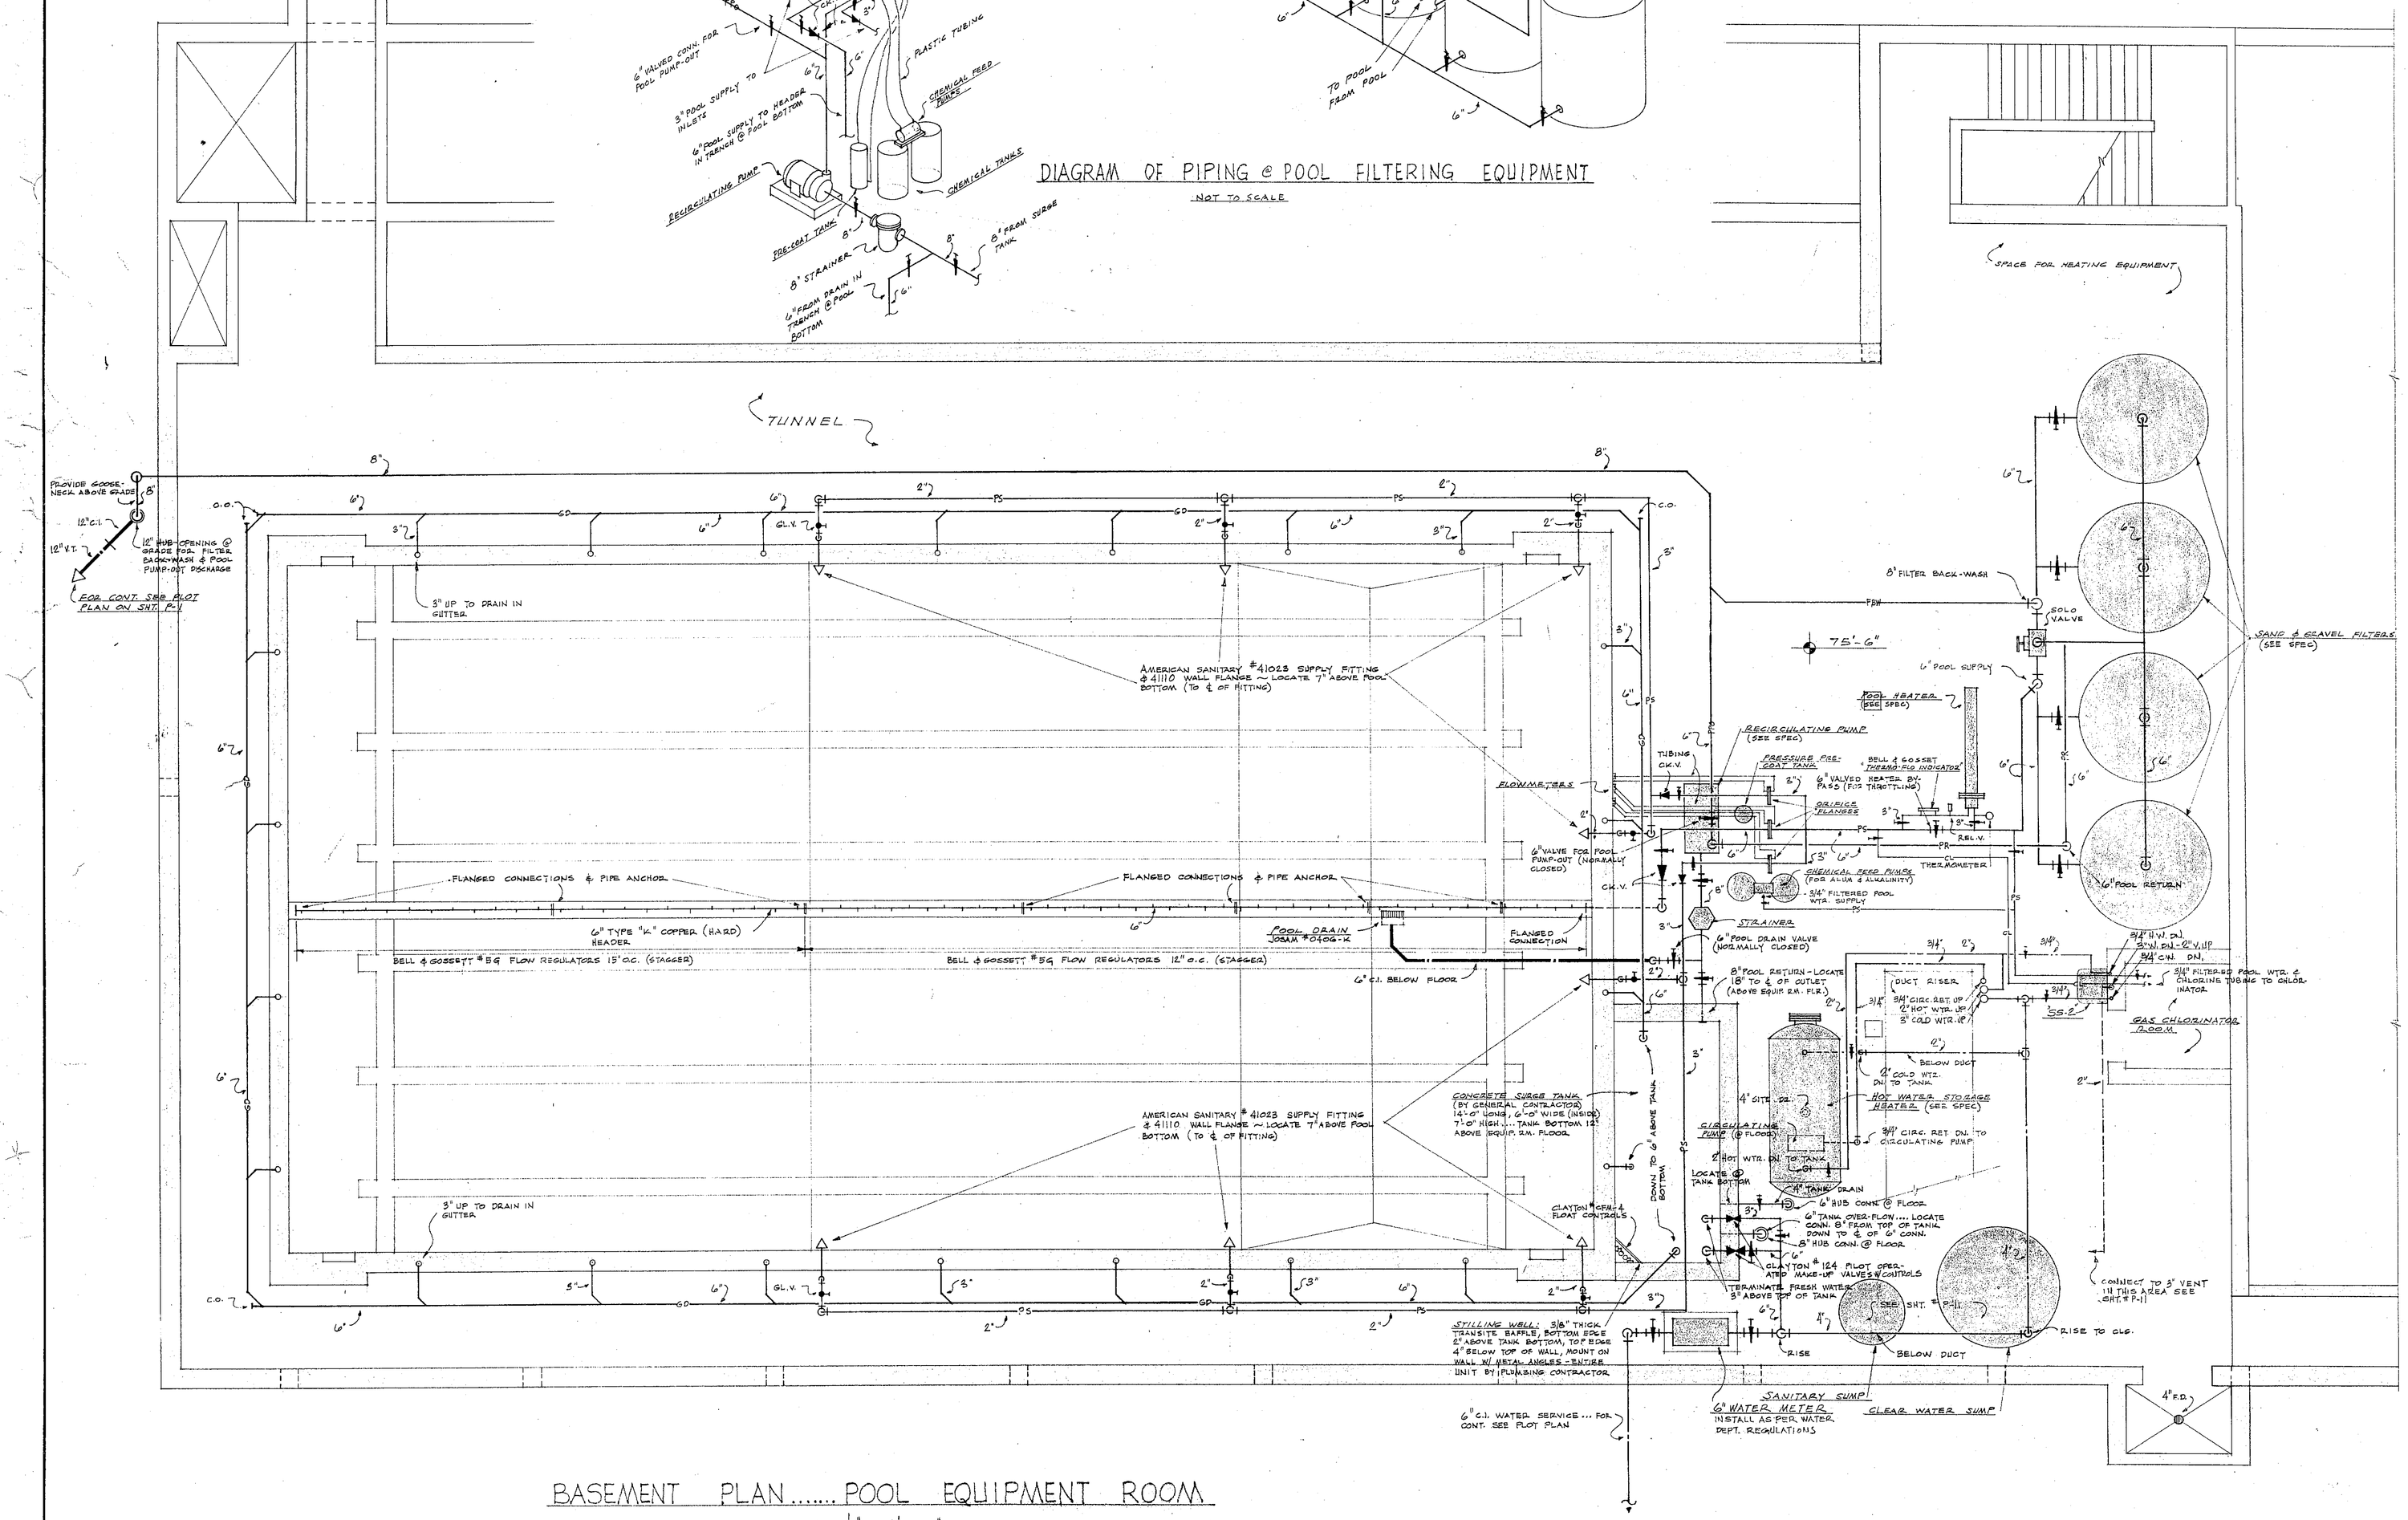

BASEMENT PLAN ..... POOL EQUIPMENT ROOM

SCALE 1/4" = 1'-0"

PROJECT Nº WIS. 3-1546

FOSTER, SHAVIE & MURRAY
ARCHITECTS INC.
407 SCOTT ST., WAUSAU, WISCONSIN

POOL DETAILS
UNIT "C"

PHYSICAL EDUCATION BUILDING
UNIVERSITY OF WISCONSIN
MARATHON COUNTY CAMPUS
WAUSAU WISCONSIN

SCALE 1/4" = 1'-0" DRAWN BY L. & G.
DATE DEC. 15, 1966 CHECKED BY P.V.G.

6512 PROJECT NO.

P-15 SHEET NO.

DESIGN PRODUCTS CO. 4-66